


(2) 1-1/2" Ø HOLES 1-3/4" FROM TOP OF THE BOX

RADIO READ UNIT (MXU) TO BE INSTALLED ON SERVICE LINES AS INDICATED BY METRO WATER SERVICE PERMIT OFFICE. REFERENCE DETAIL WDET 002A-1 FOR STANDARD METER BOX RADIO READ UNIT (MXU) CONDUIT AND MOUNTING LOCATIONS.

METER BOX MUST BE APPROVED CONCRETE OR BRICK CONSTRUCTION WITH CONCRETE BASE

TOP OF METER FRAME TO OUTER EDGE OF PRECAST BOX TO BE ROUNDED OFF WITH CONCRETE WHERE THERE IS NO SIDEWALK

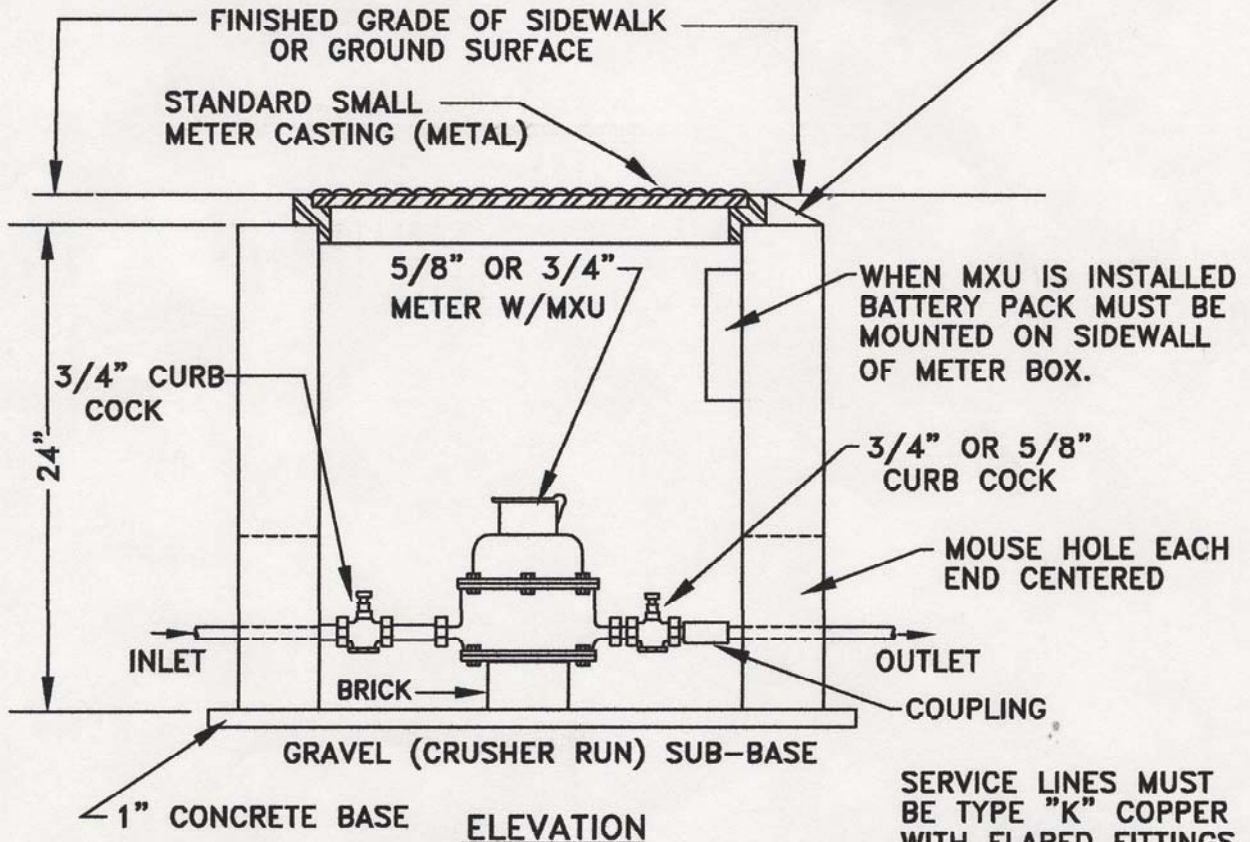

CONCRETE: 4500 PSI @ 28 DAYS

SERVICE LINES MUST BE TYPE "K" COPPER WITH FLARED FITTINGS IN METER BOX.

METRO WATER SERVICES

STANDARD 5/8" OR 3/4" METER AND BOX DETAIL

NOT TO SCALE DATE: 7/7/04

DWG. NO. WDET002

**METRO**  
WATER SERVICES

*Hal Battrop*  
LICENSED DISTRIBUTION OPERATOR

*S. P. Battrop*  
DIRECTOR OF WATER AND SEWERAGE SERVICES